

### Outdoor Conditions

Outdoor Air Temp.  
Outdoor Air Humidity  
Outdoor Air Enthalpy




- West AHU S1
- Floor Plan
- Fast Look
- VAV'S 1st Floor
- VAV'S 3rd Floor
- East AHU S2
- Chiller System
- Make-Up Units
- VAV'S 2nd Floor



NW	NE
SW	SE

### Fifth Floor Plan - South East Quadrant

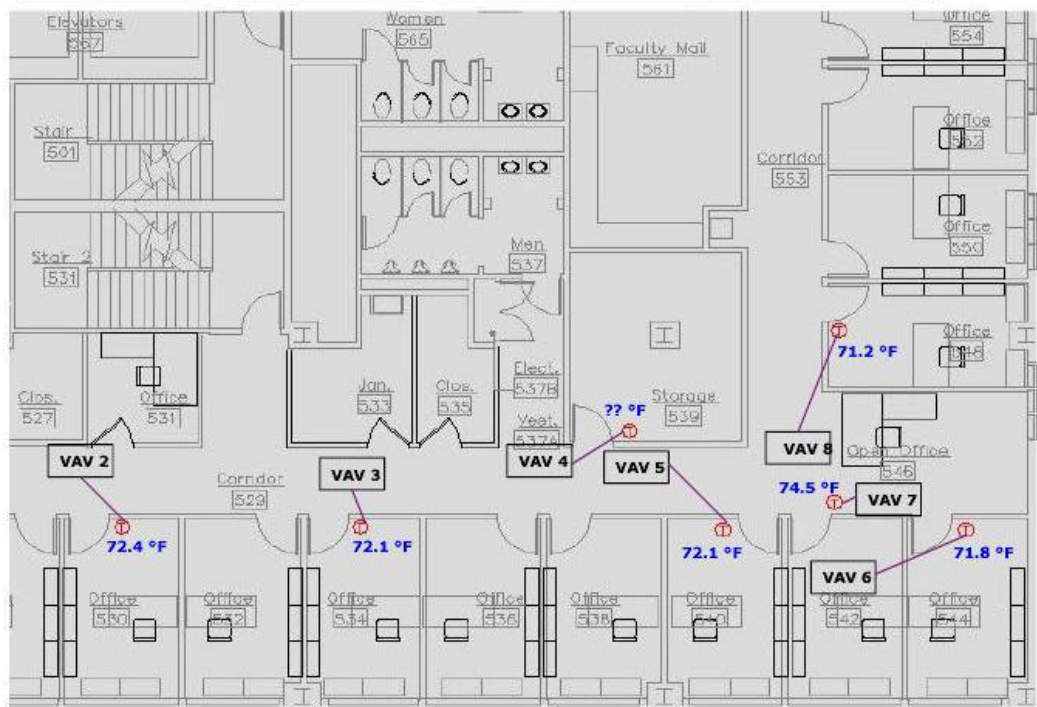

- First Floor
- Second Floor
- Third Floor
- Fourth Floor

Main Menu




NW	NE
SW	SE

# Fourth Floor Plan - North East Quadrant



- First Floor
- Second Floor
- Third Floor
- Fifth Floor

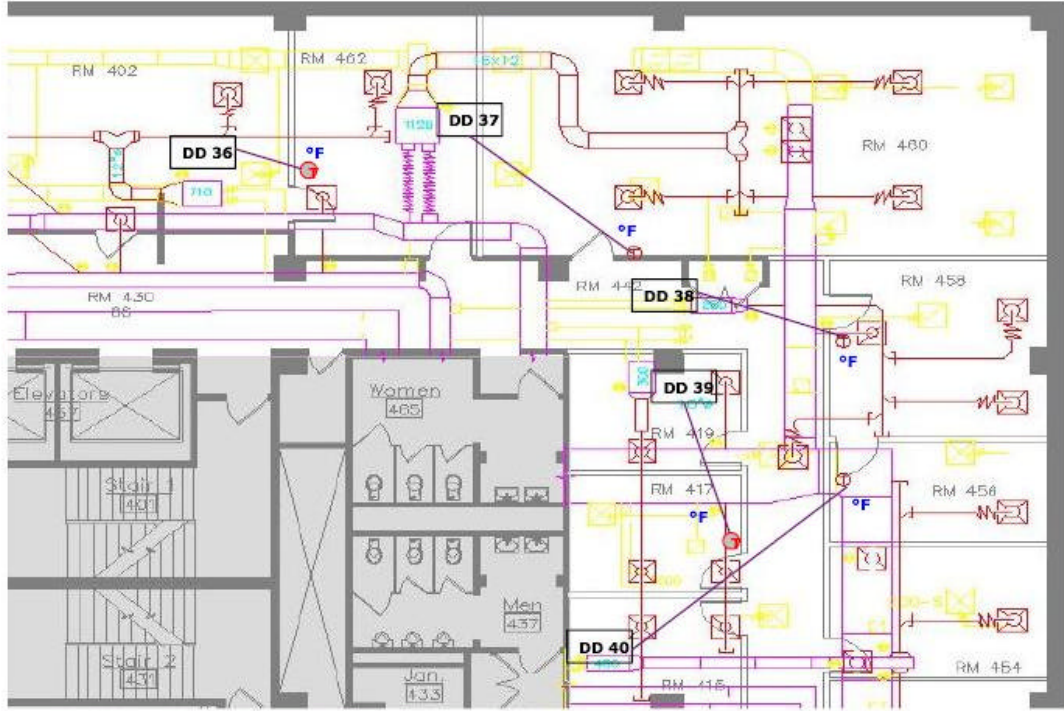

Main Menu



[Exit/Logout](#)

Date: 04-Jan-2006  
 Time: 8:10 AM  
 Outdoor air: 42.3 °F  
 Outdoor Humid: 92.6 %

Enthalpy set: 23  
 Enthalpy: 16  
 Economizer: ON

Heat lockout: 65 °F  
 Heating season: ON  
 Cool Lockout: 70 °F  
 Cooling Season: OFF

- Main
- Fan 1
  - Fan 1 Zones
- Fan 2
  - Fan 2 Zones
- Fan 3
- Training room
- Conference room
- Boiler
- Chiller
- Door Access
- General

Door	Strike:	Status:	Last Card:	Time of last swipe:
North Door:	Unlocked	Off	11 11520	05:56:39 04-Jan-2006
South Door:	Unlocked	Off	127 30466	05:55:23 04-Jan-2006
Garage Door:	Unlocked	Off	127 30493	10:40:58 04-Jan-2006
Front Door:	Unlocked	Off	203 45987	19:38:38 20-Dec-2005

Daytime Access Schedule      Holiday Calendar

Gibson Report

Advocate Report

John Buck Report

All Users Report

Access Log

Date: 04-Jan-2006  
Time: 8:10 AM  
Outdoor air: 42.4 °F  
Outdoor Humid: 92.5 %


Enthalpy set: 23  
Enthalpy: 16  
Economizer: ON

Heat lockout: 65 °F  
Heating season: ON  
Cool Lockout: 70 °F  
Cooling Season: OFF

- Main
- Fan 1
- Fan 1 Zones
- Fan 2
- Fan 2 Zones
- Fan 3
- Training room
- Conference room
- Boiler
- Chiller**
- Door Access
- General

Trend

AHU 1 Cool request: OFF  
AHU 2 Cool request: OFF  
Cooling available: OFF

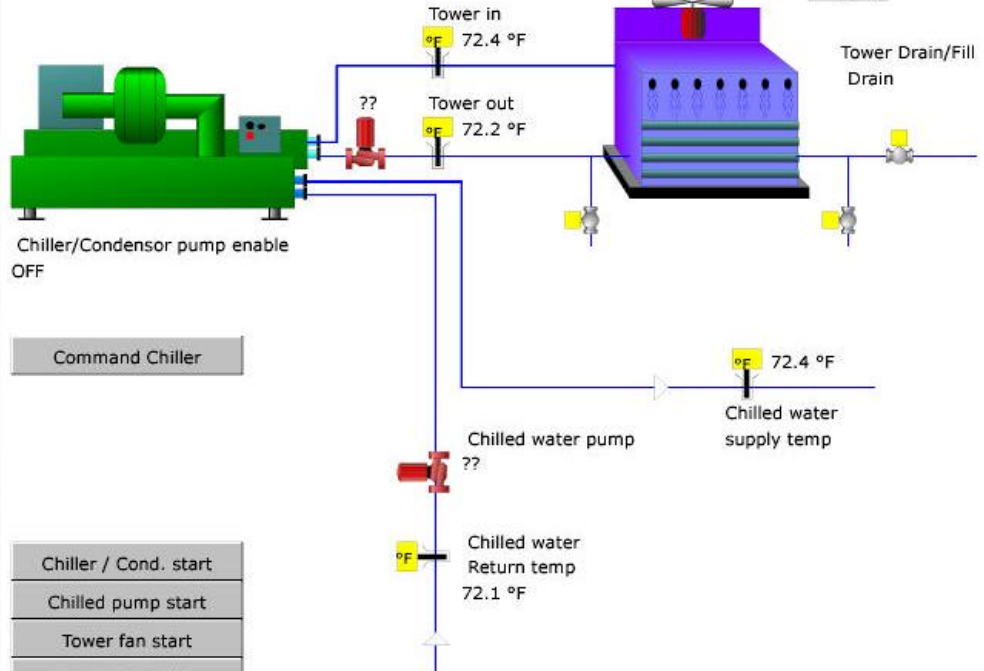


Date: 04-Jan-2006  
Time: 10:57:33.5

**AC-3**

DAT Setpoint: 55.0 °F  
Duct Static Setpoint: 1.0 in H2O  
Min OSA Damper SP: 0.0 %  
Summer / Winter: OFF  
Cooling Stage1 Request: ON  
Cooling Stage2 Request: ON

Supply Setpoint Reset

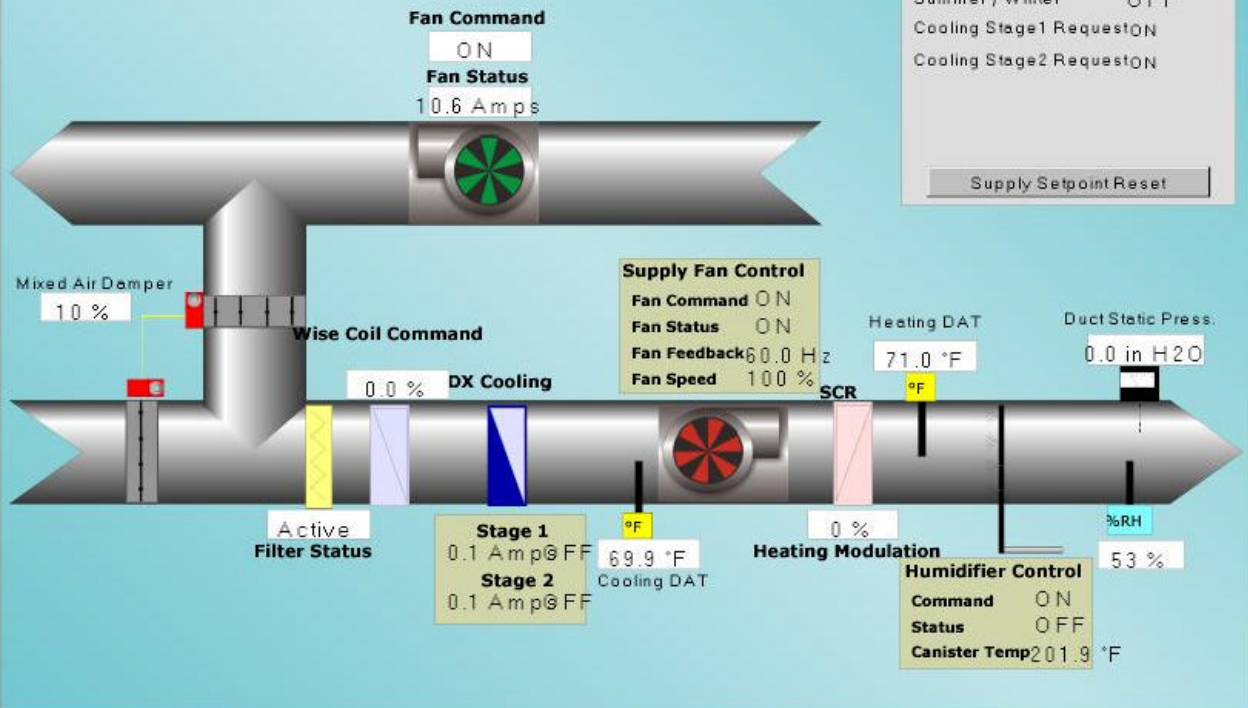

Main Weekly Schedule

- Main Menu
- Chiller System
- AC-1
- Fluid Cooler
- AC-5
- AC-1 VAV Report
- Space Humidity TL
- Heat Exchanger
- Boiler System
- AC-2
- AC-4
- AC-6
- AC-3 VAV Report
- CW Pumps

